



LIST OF DRAWING **PROJEK :** **CADANGAN NAIKTARAF DEWAN KULIAH 1, DEWAN KULIAH 2 & 3 UNIT RUANG PARKIR BERBUMBUNG DI MASMED, UTM SHAH ALAM, SELANGOR**

**PROJEK : CADANGAN NAIKTARAF DEWAN KULIAH 1, DEWAN KULIAH 2 & 3 UNIT RUANG PARKIR
BERBUMBUNG DI MASMED, UTM SHAH ALAM, SELANGOR**

[illegible]

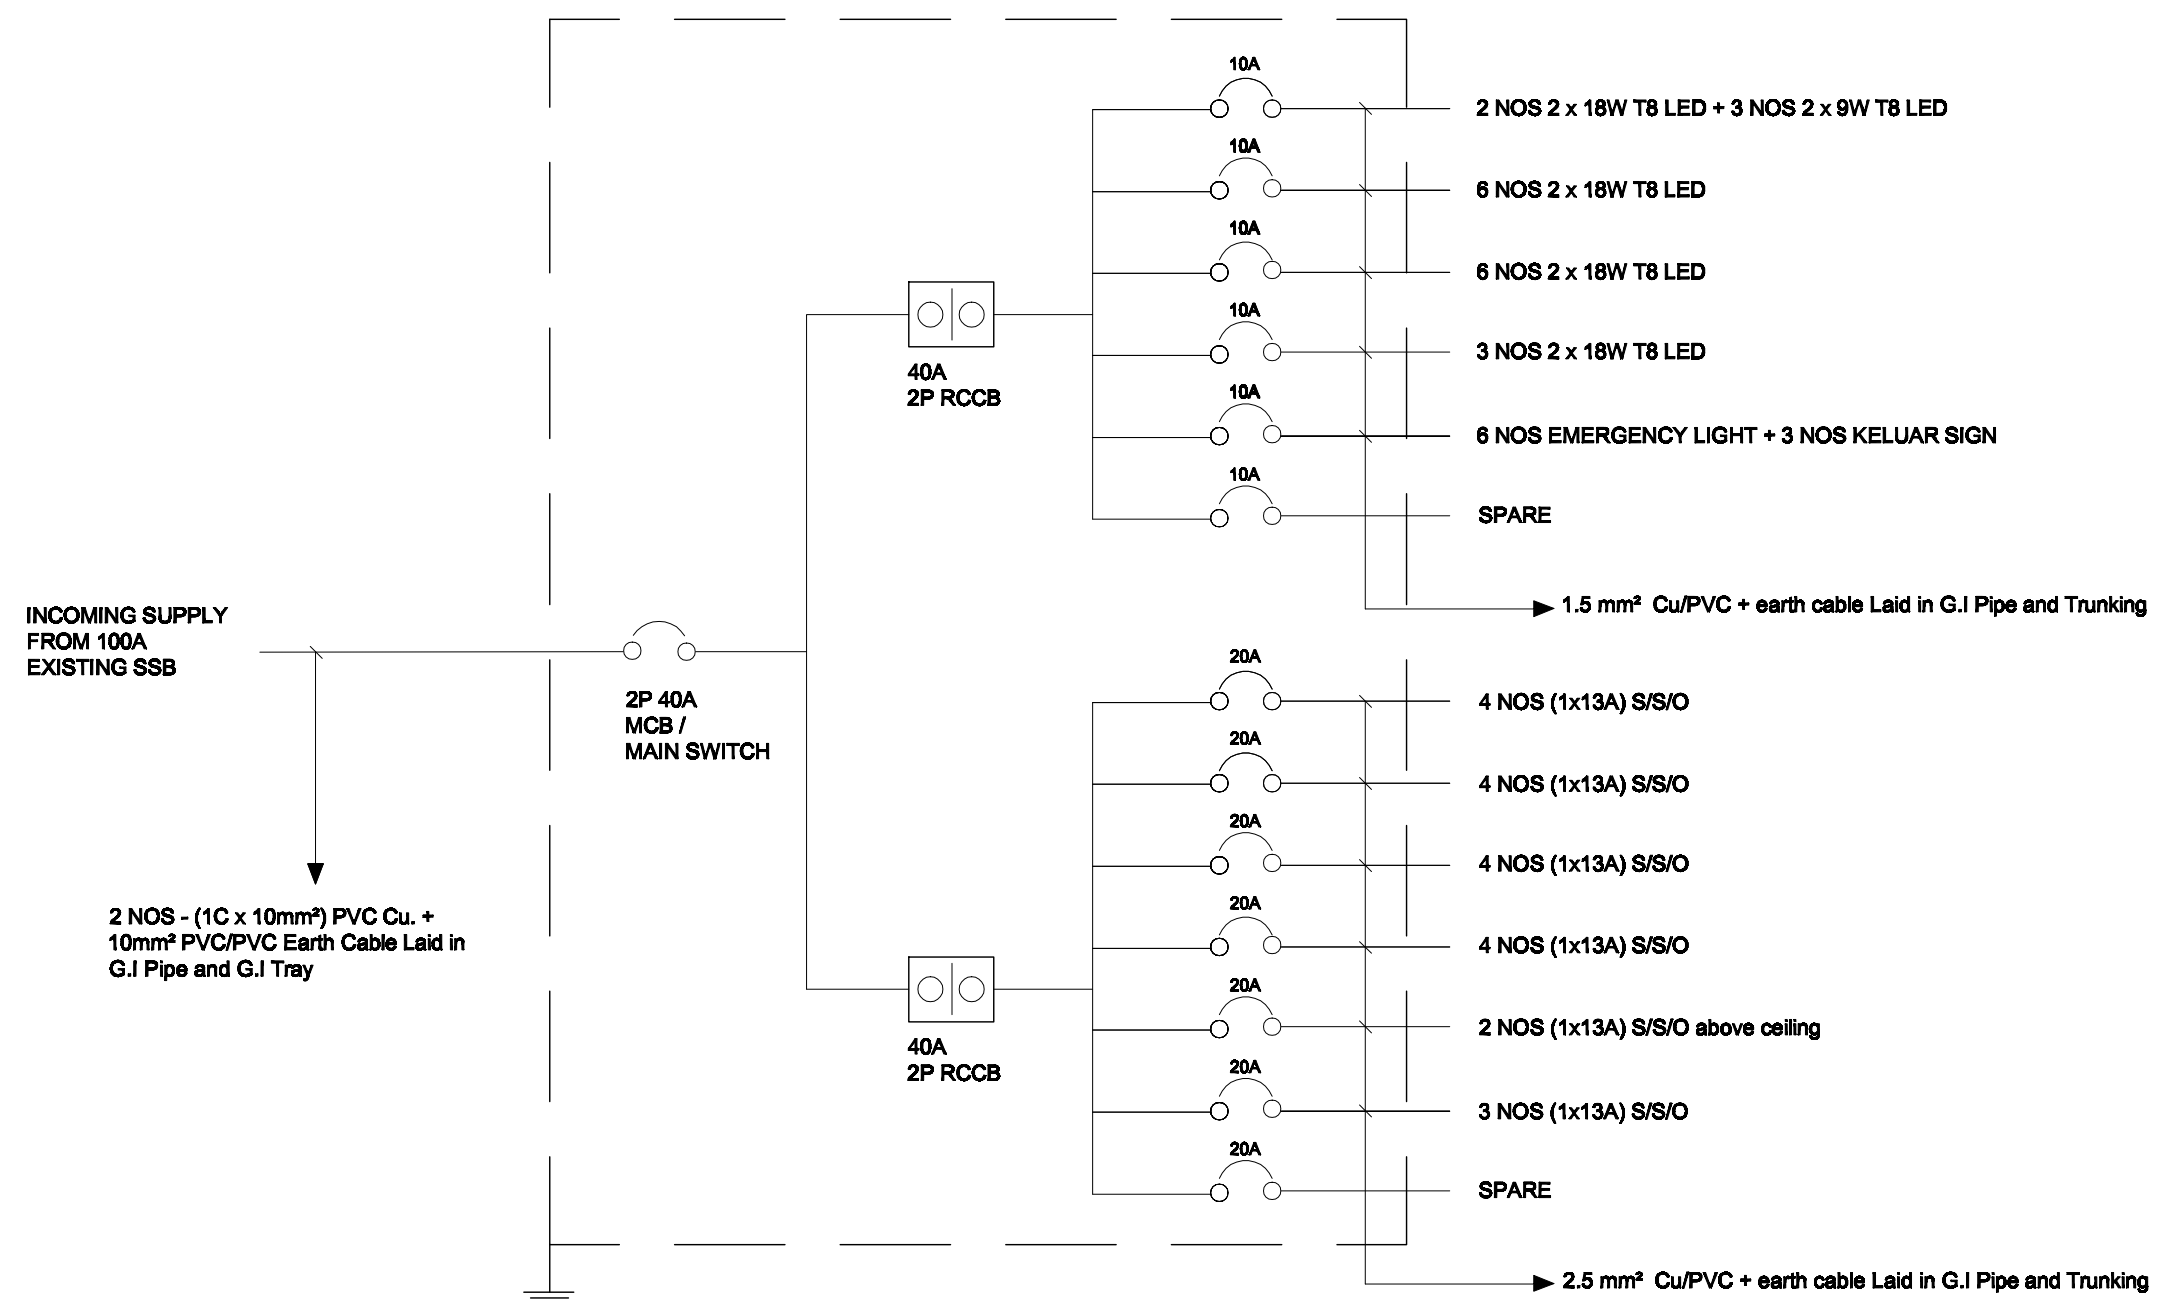

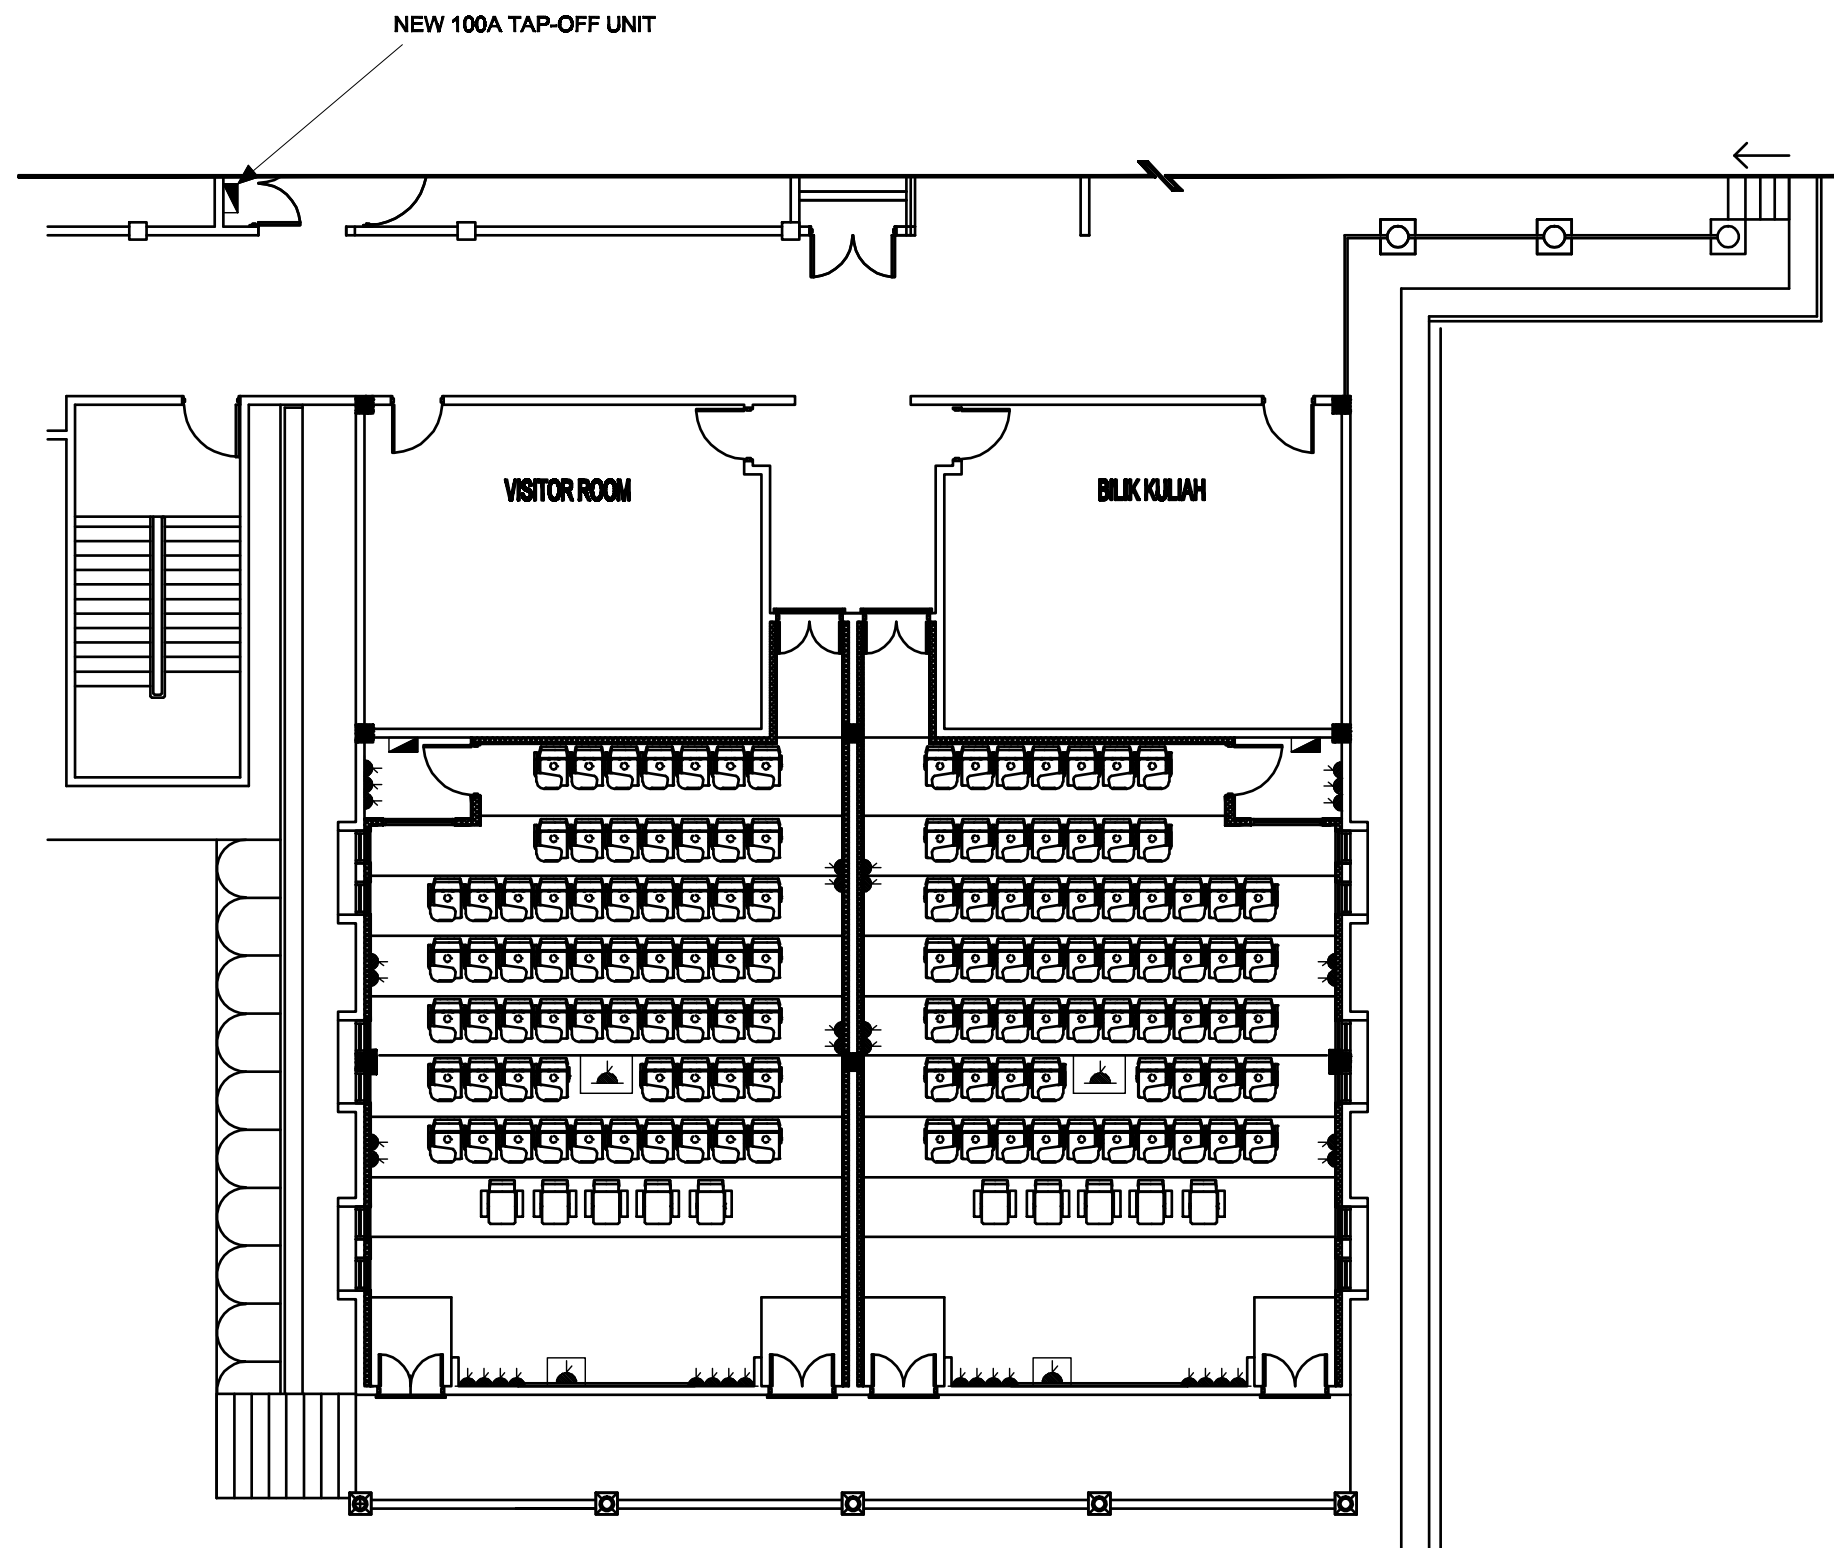

NOTE:—

- IF THERE IS ANY EQUIPMENT AND INSTALLATION AS IT CONSIDERS NECESSARY FOR PROPER FUNCTIONALITY OF THE ENTIRE SYSTEM BUT NOT SPECIFIED IN THE BILL OF QUANTITY AND DRAWINGS, THE CONTRACTOR IS OBLIGED TO ENSURE THAT ALL EQUIPMENT AND INSTALLATIONS ARE PROPERLY INSTALLED IN ACCORDANCE WITH JKR STANDARD & UiTM ELECTRICAL ENGINEER APPROVAL AND ALL COSTS MUST BE BORNE BY THE CONTRACTOR
- ELECTRICAL COMMON SUPPLY TO BE TAKEN FROM EXISTING ELECTRICAL SOURCE. ANY MODIFICATION ON THE EXISTING ELECTRICAL SOURCE IN ORDER TO SUIT WITH NEW ELECTRICAL SYSTEM ARE UNDER CONTRACTOR RESPONSIBILITY.
- CIRCUIT DEMARCATION ON DRAWING ARE FOR REFERENCE PURPOSE ONLY. THE CONTRACTOR SHALL ENSURE THAT THE CIRCUIT IS EQUILLY DEVIDED/BALANCE BY 3 PHASE SUPPLY ON EXISTING ELECTRICAL BOARD AND SUBJECT TO UiTM ELECTRICAL ENGINEER APPROVAL.
- CONTRACTOR SHALL ENSURE ALL MODIFICATION & MAKING GOOD ON EXISTING FLOORS, CEILINGS AND WALLS THAT ARE AFFECTED TO COMPLETE ELECTRICAL WORKS.

LEGENDS

SYMBOL	DESCRIPTION
	NEW DB
	1 x 13A S/S/O
	1 x 13A S/S/O (ABOVE CEILING)



LUKISAN SEBUT HARGA

PROJEK:
CADANGAN NAIKTARAF DEWAN KULIAH 1, DEWAN KULIAH 2 & 3 UNIT RUANG PARKIR BERBUMBUNG DI MASMED, UiTM SHAH ALAM, SELANGOR



NO. RUJUKAN PROJEK:
200-PPI(BP15/3/159)[4002] ELEC

TAJUK LUKISAN:
NEW SSO PLAN

TARIKH:
20/04/25 JANUARY

SKALA:
NTS

NAIB CANSelor : DATUK PROF. DATUK TS. DR. SHAHRIN SAHIB

PENGLONG NAIB CANSelor : PROF. TS. SR. DR. MD YUSOF HAMID, PMP, AMP

PENGARAH KHIDMAT PEMBANGUNAN : IR. TS. AZMAN SAUBIRAN

KETUA BAHAGIAN PEMBANGUNAN INFRA: TS. MOHAMMED IZRAI BIN ABD RAZAK


ARKITEK / DISEMAK : ZULFADLI BIN MOHAMED SALLEH

DILUKIS OLEH : MEGAT MOHAMAD

PENGURUS PROJEK / DISEMAK : TS. MUHAMMAD ASYRIF ABDUL AZIZ

INDEX PINDAAN

NO HELAIAN: **02**

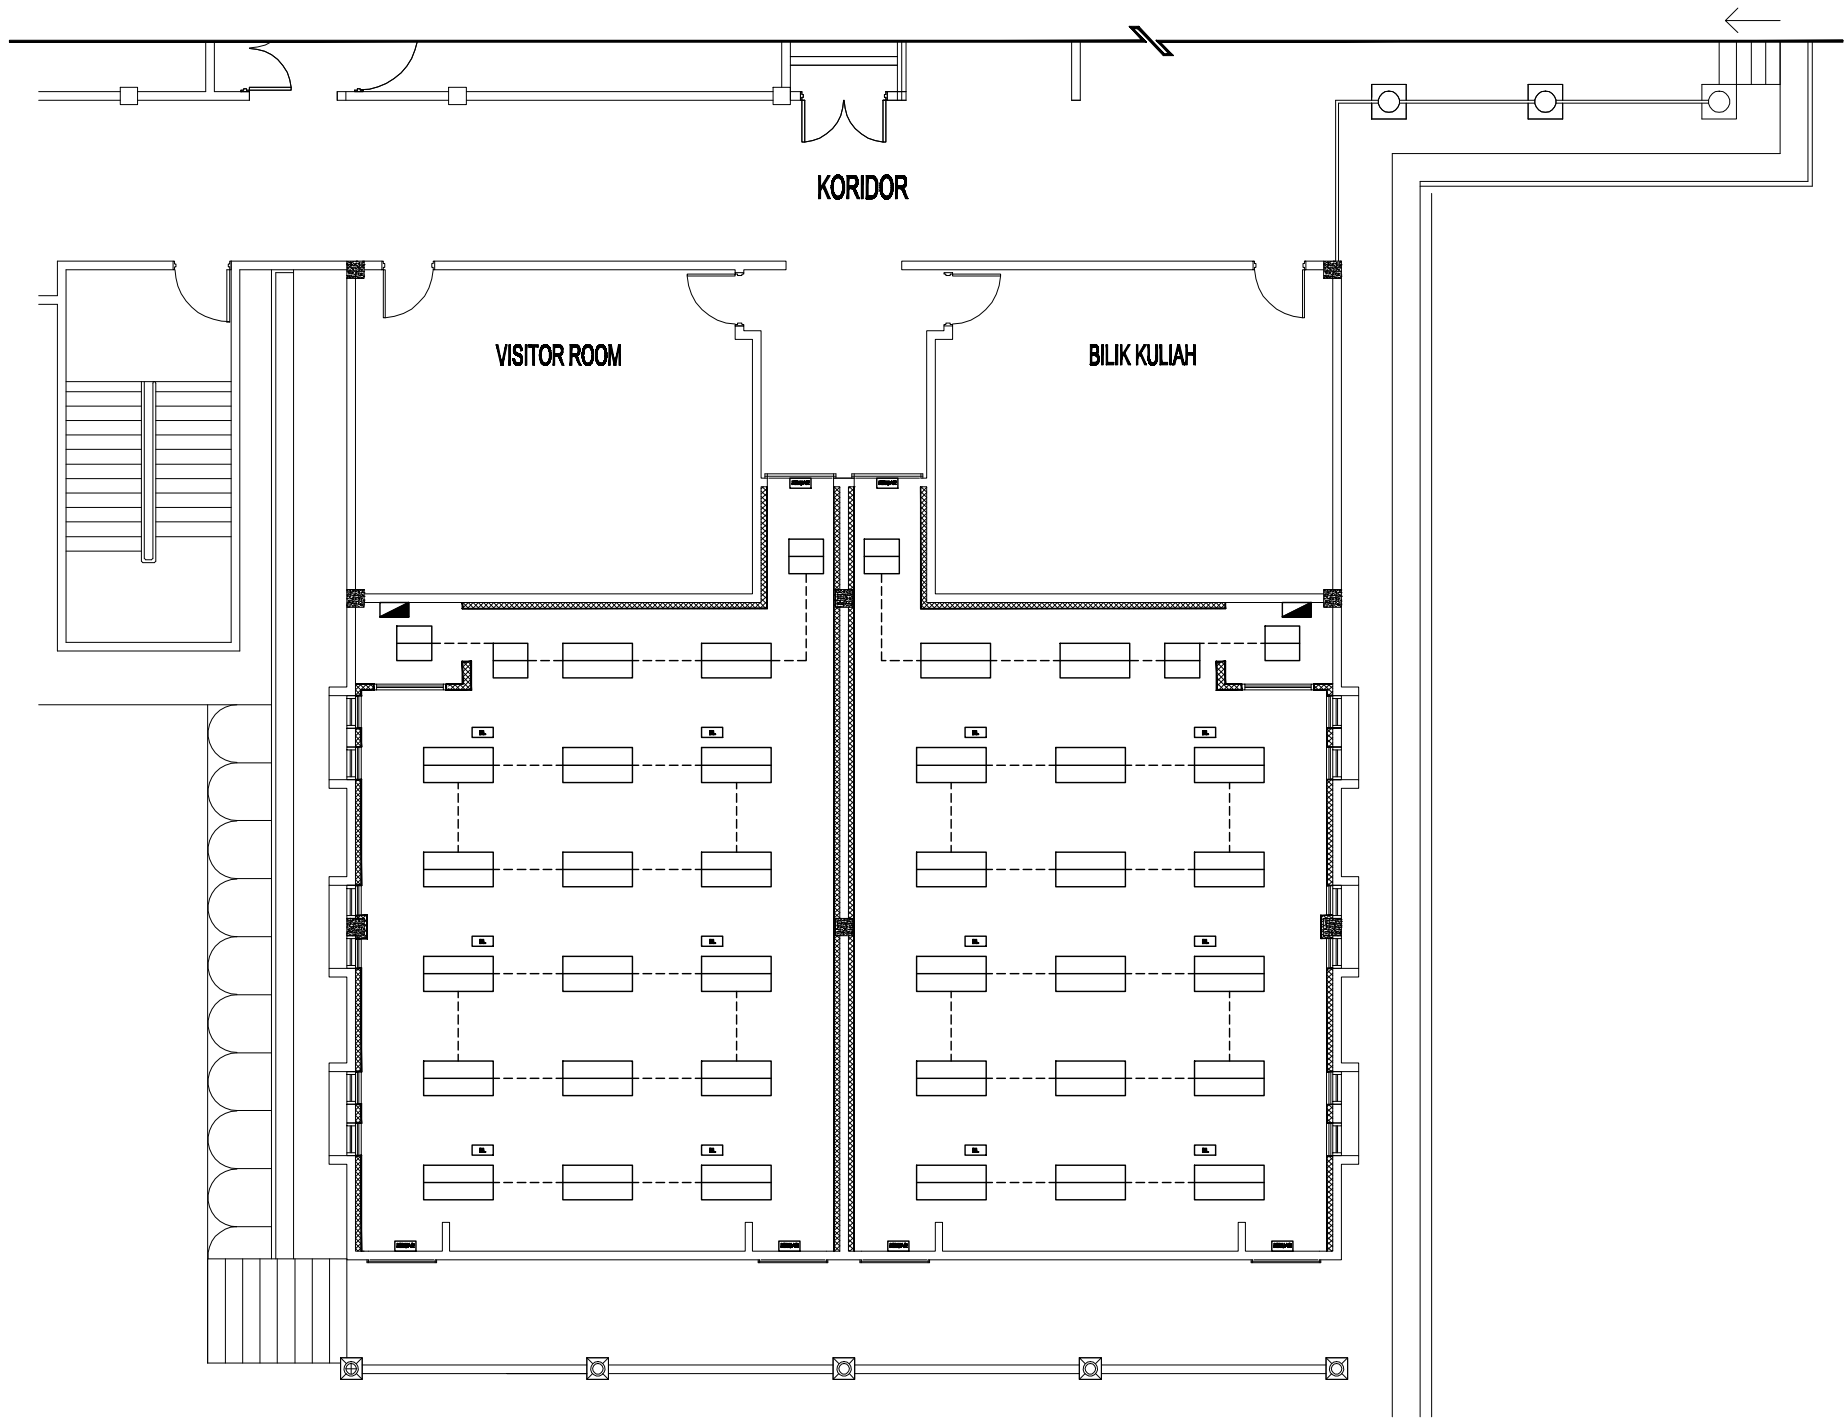

NOTE:—


- IF THERE IS ANY EQUIPMENT AND INSTALLATION AS IT CONSIDERS NECESSARY FOR PROPER FUNCTIONALITY OF THE ENTIRE SYSTEM BUT NOT SPECIFIED IN THE BILL OF QUANTITY AND DRAWINGS, THE CONTRACTOR IS OBLIGED TO ENSURE THAT ALL EQUIPMENT AND INSTALLATIONS ARE PROPERLY INSTALLED IN ACCORDANCE WITH JKR STANDARD & UiTM ELECTRICAL ENGINEER APPROVAL AND ALL COSTS MUST BE BORNE BY THE CONTRACTOR
- ELECTRICAL COMMON SUPPLY TO BE TAKEN FROM EXISTING ELECTRICAL SOURCE. ANY MODIFICATION ON THE EXISTING ELECTRICAL SOURCE IN ORDER TO SUIT WITH NEW ELECTRICAL SYSTEM ARE UNDER CONTRACTOR RESPONSIBILITY.
- CIRCUIT DEMARCATION ON DRAWING ARE FOR REFERENCE PURPOSE ONLY. THE CONTRACTOR SHALL ENSURE THAT THE CIRCUIT IS EQUILLY DEVIDED/BALANCE BY 3 PHASE SUPPLY ON EXISTING ELECTRICAL BOARD AND SUBJECT TO UiTM ELECTRICAL ENGINEER APPROVAL.
- CONTRACTOR SHALL ENSURE ALL MODIFICATION & MAKING GOOD ON EXISTING FLOORS, CEILINGS AND WALLS THAT ARE AFFECTED TO COMPLETE ELECTRICAL WORKS.

LEGENDS

SYMBOL	DESCRIPTION
	NEW DB
	EXISTING LIGHT FITTING
	NEW EMERGENCY LIGHT
	NEW KELUAR SIGN

LUKISAN SEBUT HARGA

EXISTING LIGHTING LAYOUT (REWIRING)



UNIVERSITI
TEKNOLOGI
MARA

PROJEK:
**CADANGAN NAIKTARAF DEWAN KULIAH 1, DEWAN KULIAH
2 & 3 UNIT RUANG PARKIR BERBUMBUNG DI MASMED,
UiTM SHAH ALAM, SELANGOR**

NO. RUUKAN PROJEK:
200-PPI(BPL5/3/159)[4003] ELEC
TAJUK LUKISAN:
EXISTING LIGHTING LAYOUT

TARikh:
20/04
25 JANUARY
SKALA:
NTS

NAB CANSelor	: DATUK PROF. DATUK TS. DR. SHAHRIN SAHIB
PENOLONG NAB CANSelor	: PROF. TS. SR. DR. MD YUSOF HAMID, PMP, AMP
PENGARAH KAJIAN PEMBANGUNAN	: IR. TS. AZMAN SAUBIRAN
KETUA BAHAGIAN PEMBANGUNAN INFRA	: TS. MOHAMMED IZRAI BIN ABD RAZAK
ARKITEK / DISEMAK	: ZULFADLI BIN MOHAMED SALLEH
DILUKIS OLEH	: MEGAT MOHAMAD
PENGURUS PROJEK / DISEMAK	: TS. MUHAMMAD ASYRIF ABDUL AZIZ

INDEX PINDAAN	
NO HELAIAN	03